



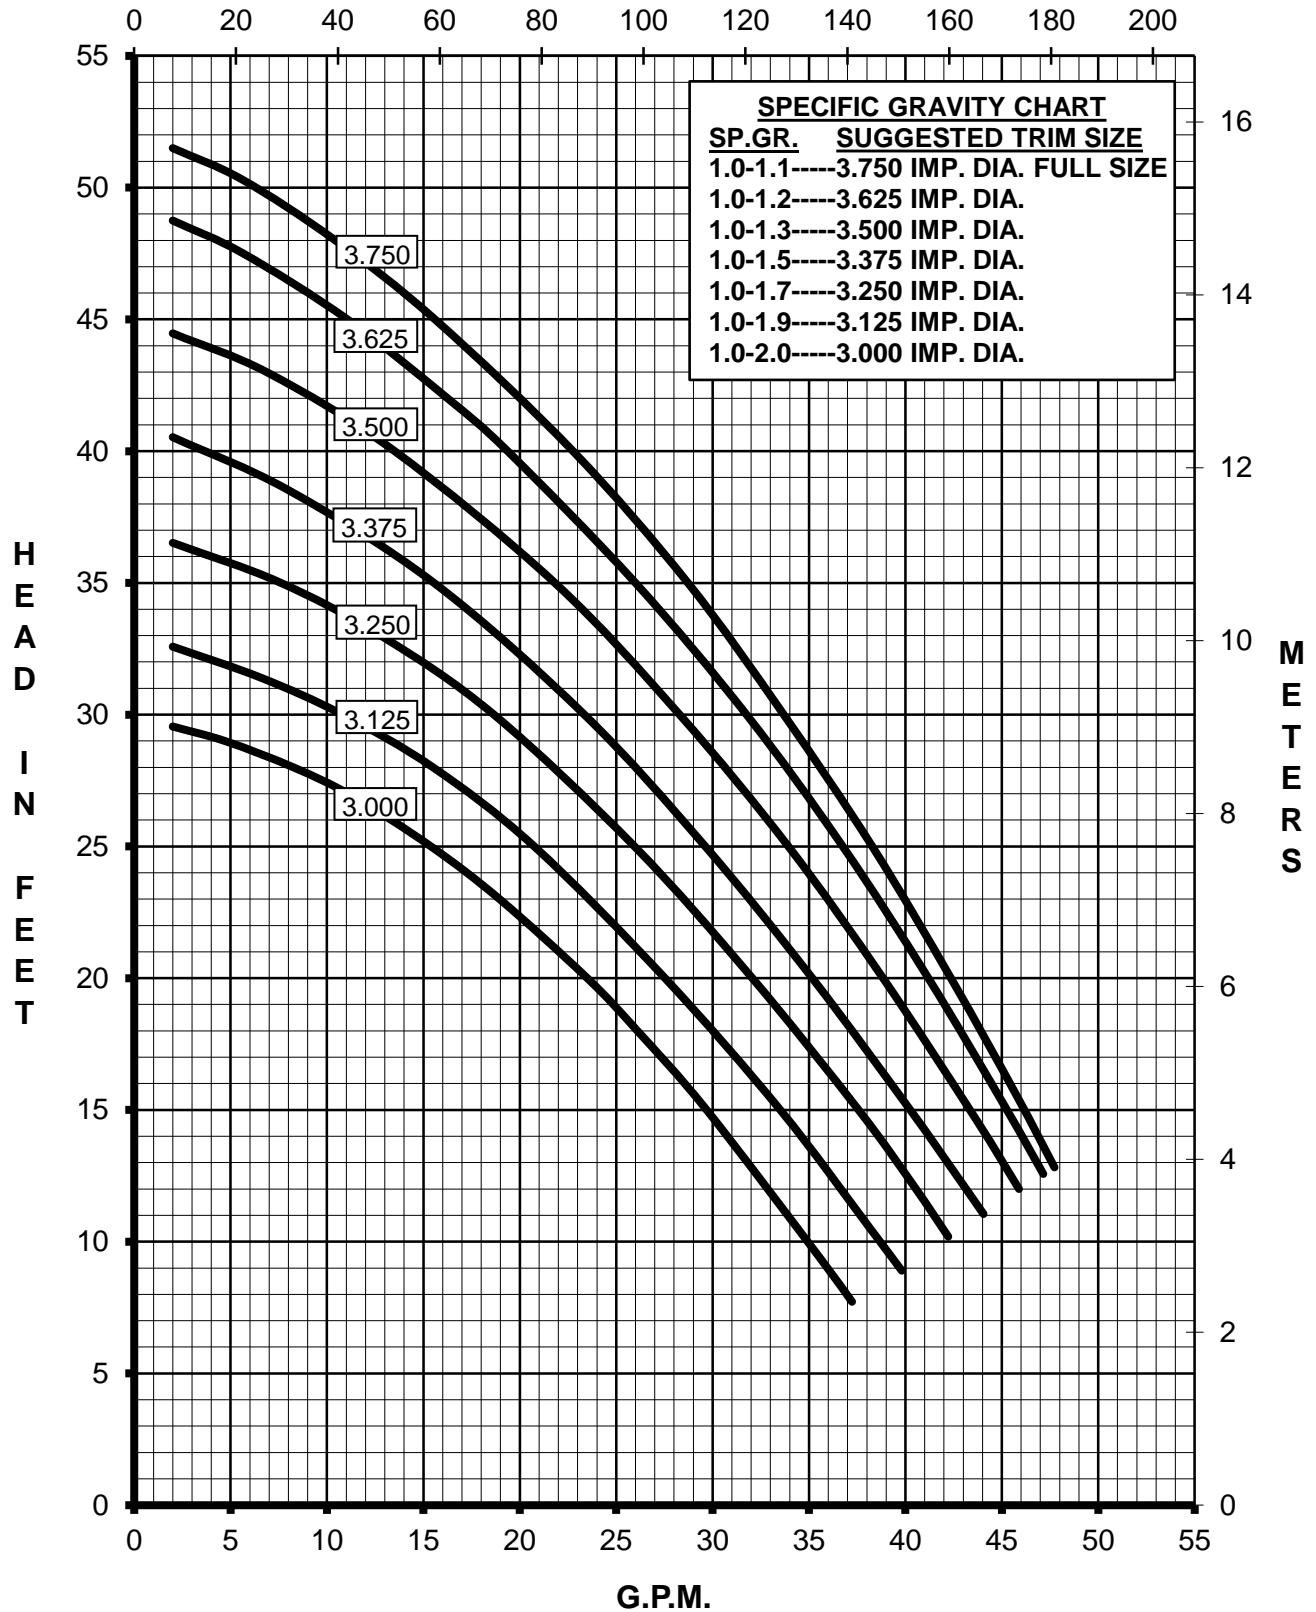

MARCH PUMPS

SP-TE-7P-MD
SP-TE-7K-MD
1PH, 3PH, 60HZ



L.P.M.

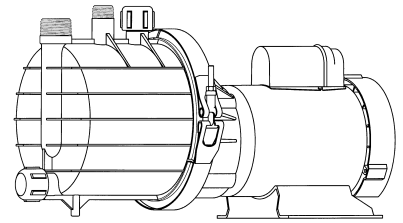



MARCH PUMPS

SP-TE-7P-MD
SP-TE-7K-MD
FULL SIZE IMPELLER 3.750 DIA.
1PH, 3PH 60HZ
L.P.M.

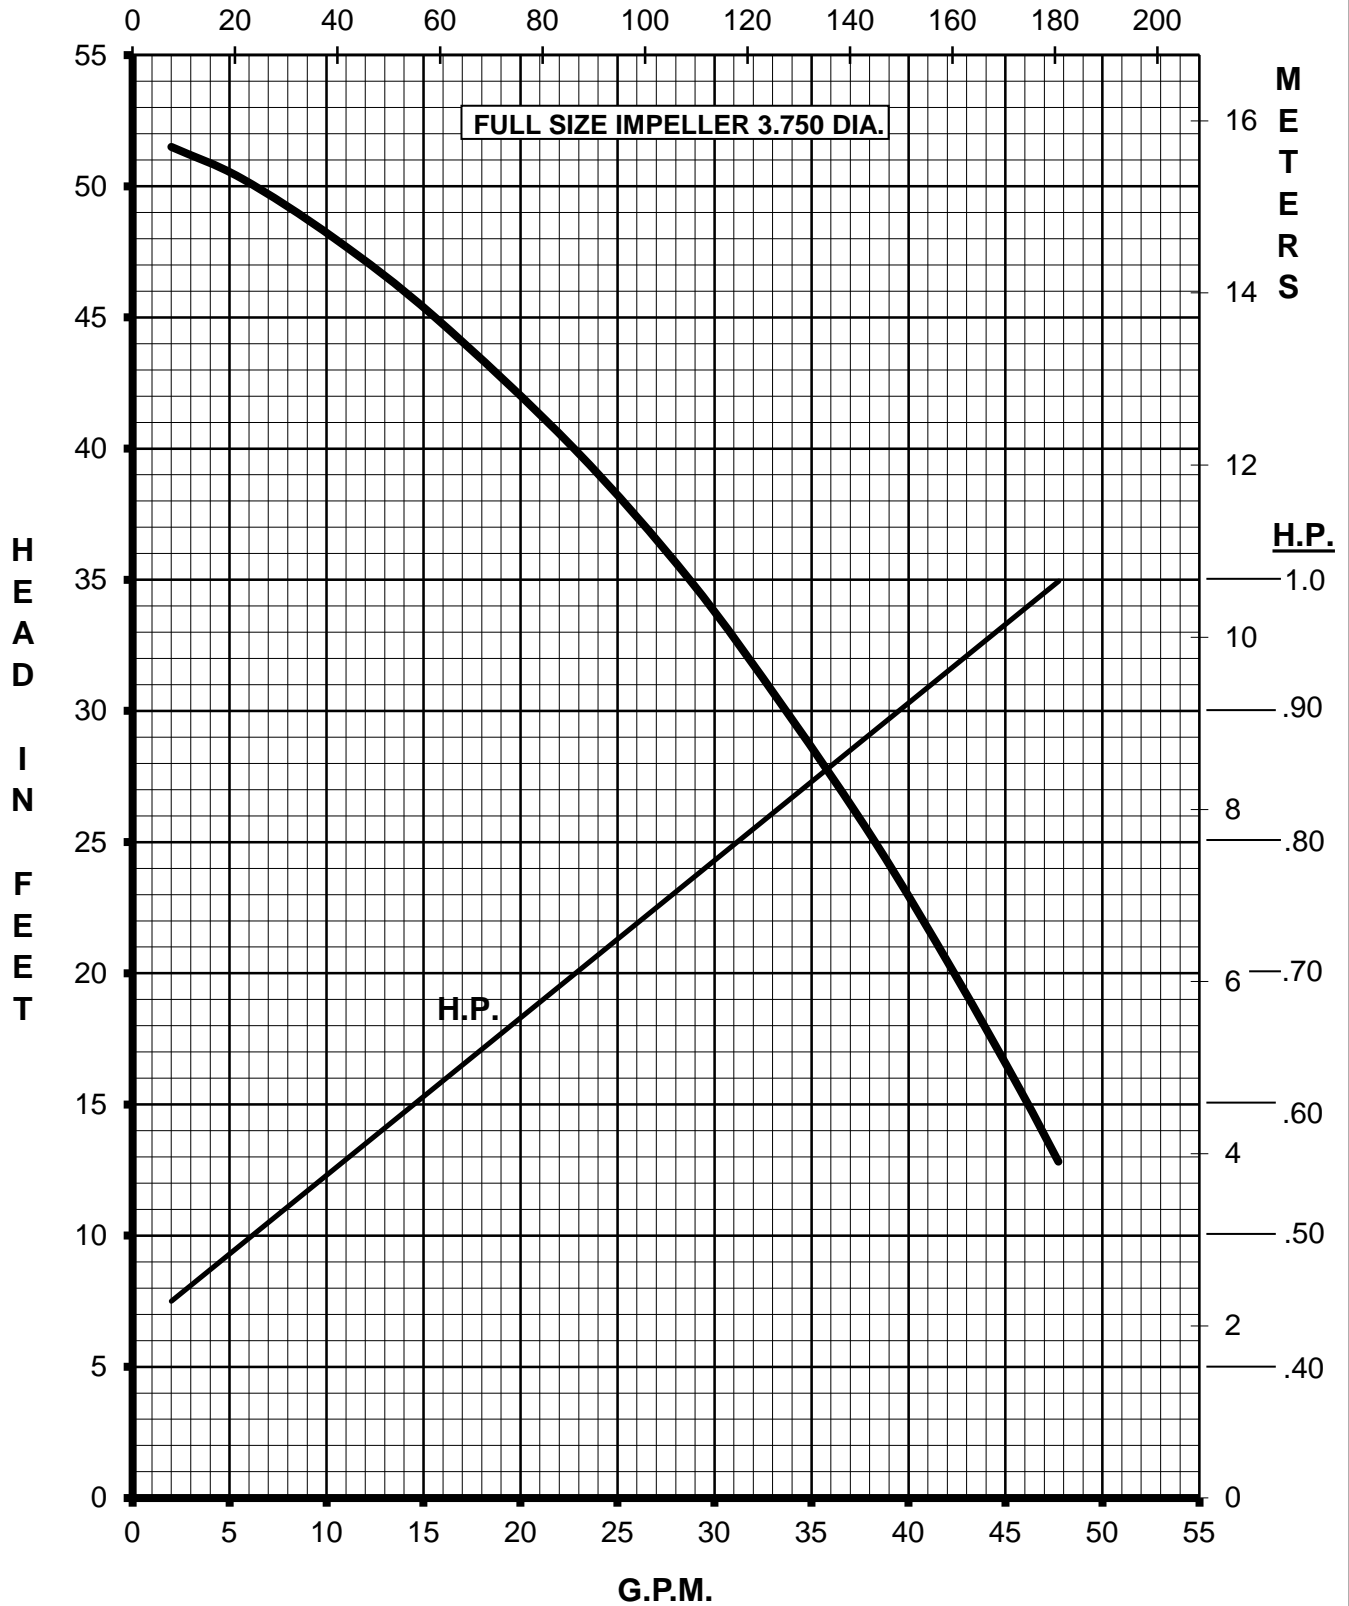
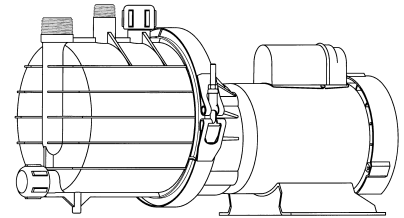


CURVES ARE AT 1FT SUCTION LIFT



MARCH PUMPS

SP-TE-7P-MD
SP-TE-7K-MD
TRIM IMPELLER 3.625 DIA.
1PH, 3PH 60HZ
L.P.M.

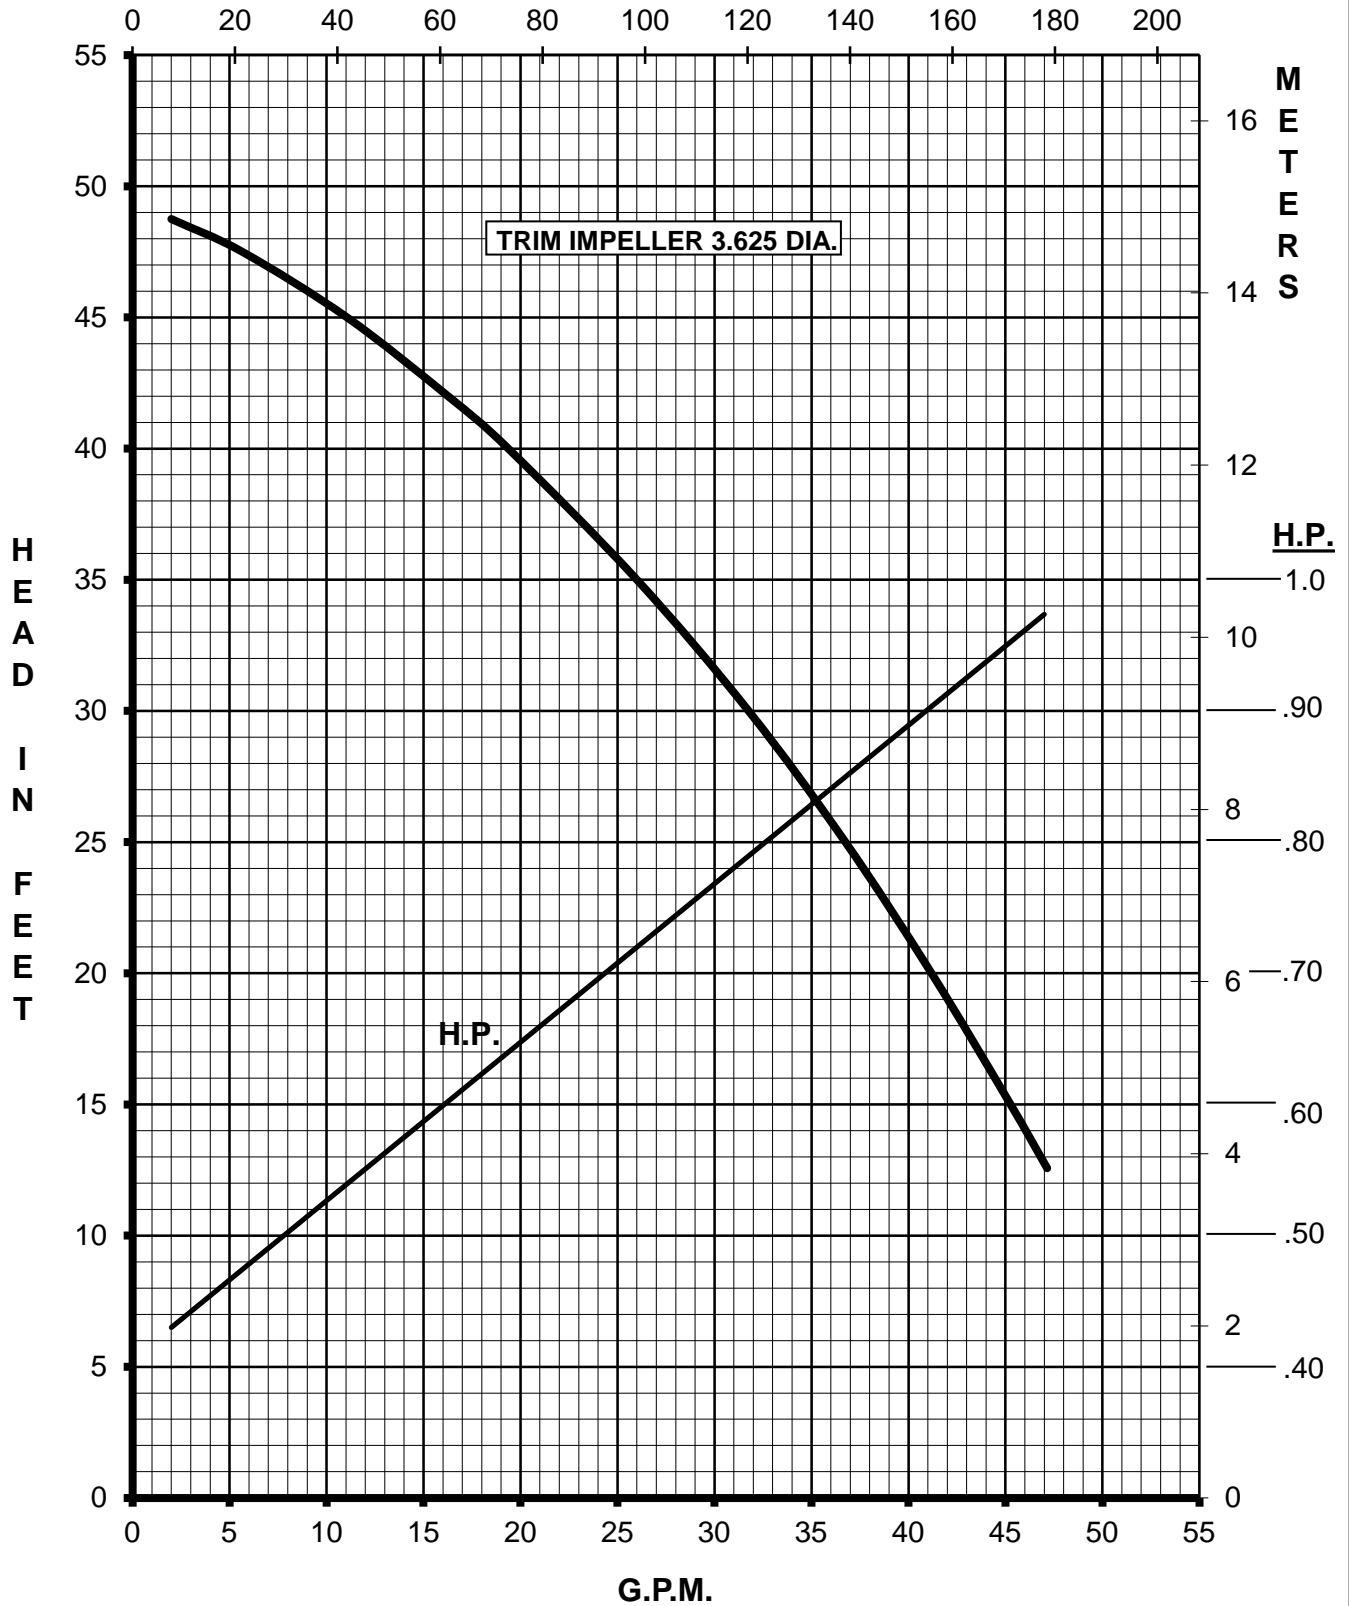
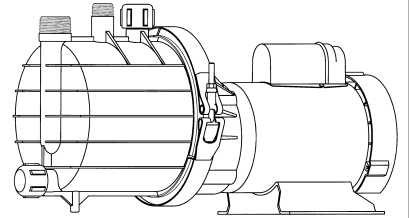


CURVES ARE AT 1FT SUCTION LIFT



MARCH PUMPS

SP-TE-7P-MD
SP-TE-7K-MD
TRIM IMPELLER 3.500 DIA.

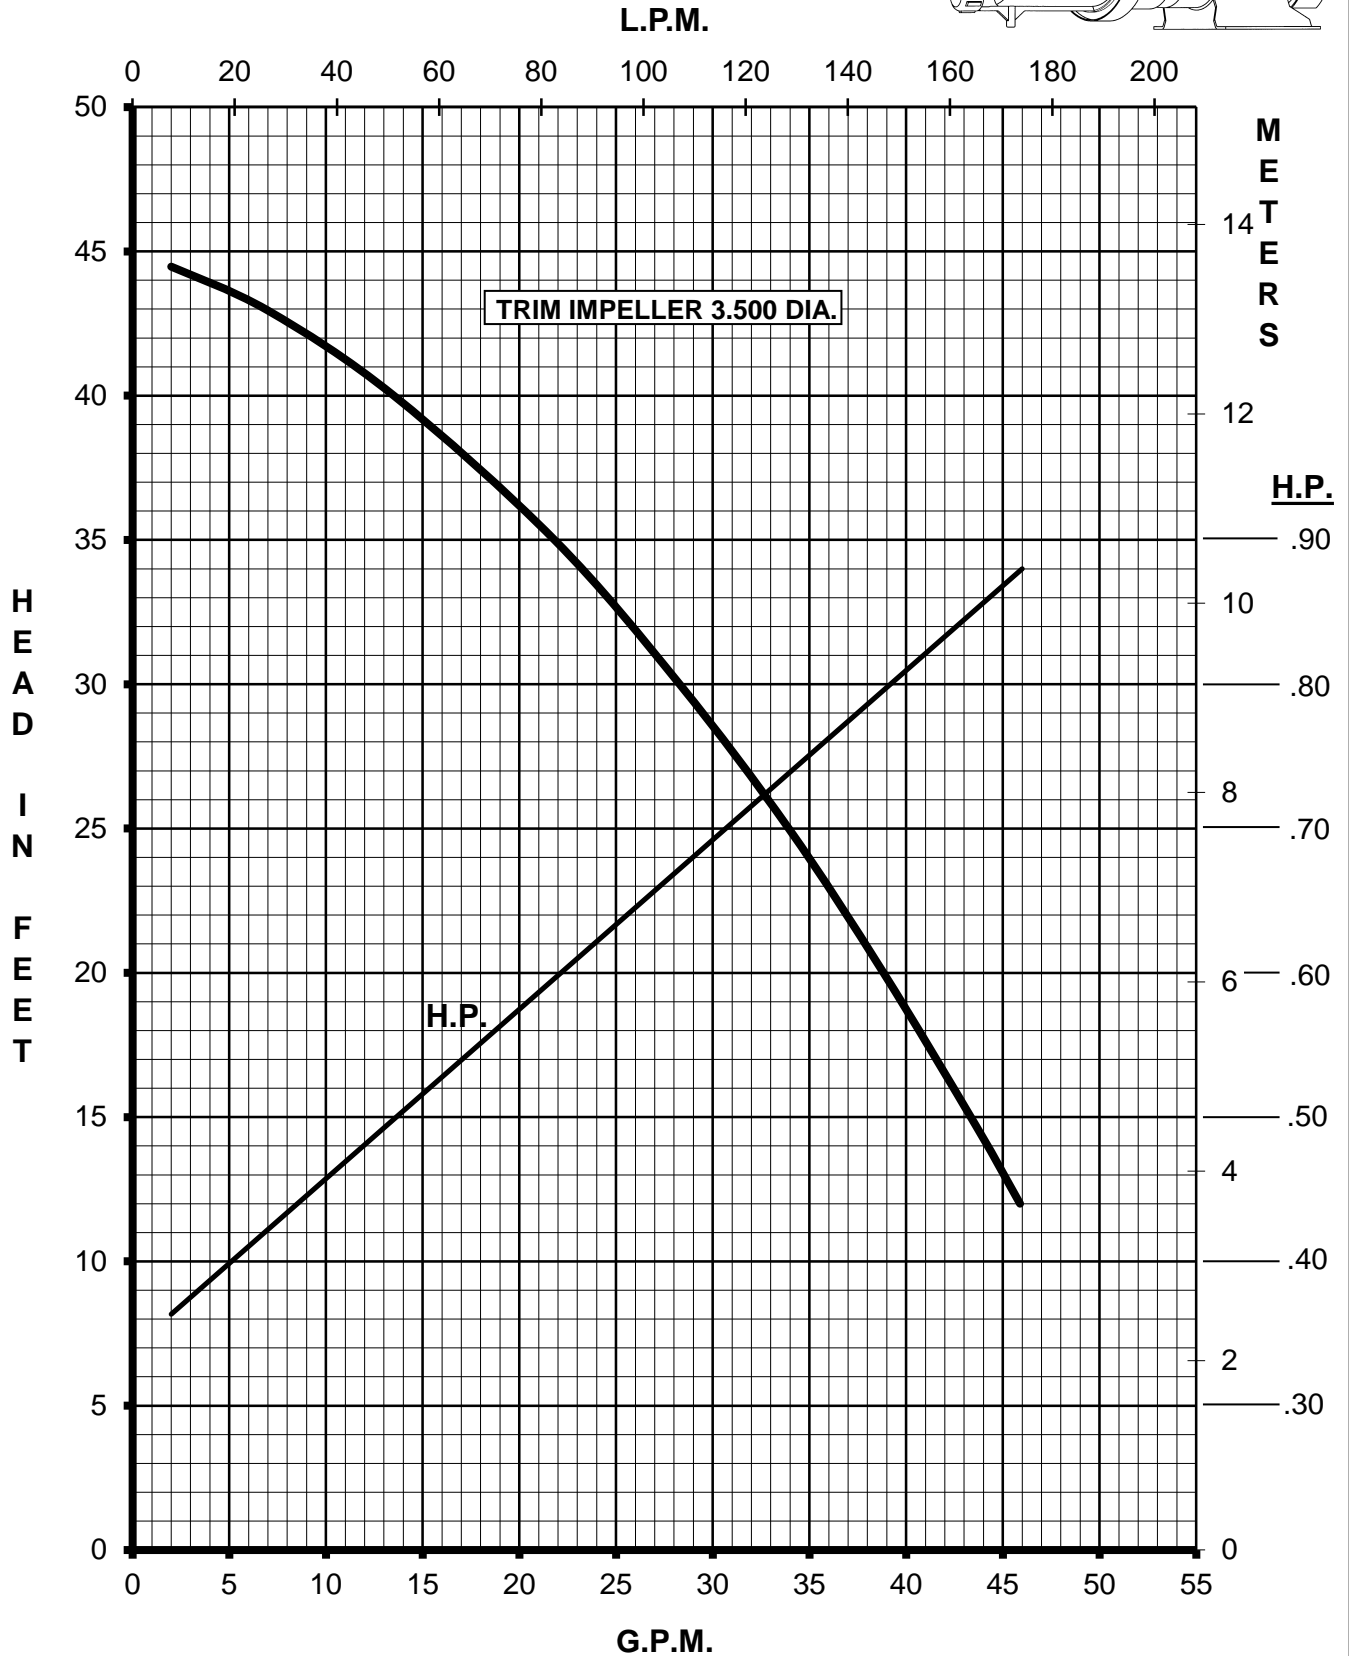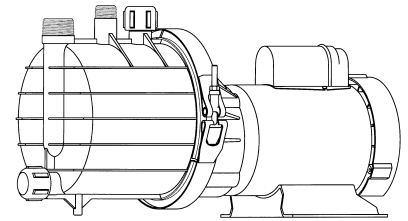


CURVES ARE AT 1FT SUCTION LIFT




MARCH PUMPS

SP-TE-7P-MD
SP-TE-7K-MD
TRIM IMPELLER 3.375 DIA.
1PH, 3PH 60HZ

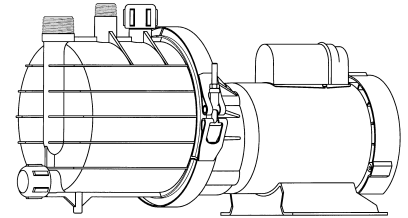

L.P.M.


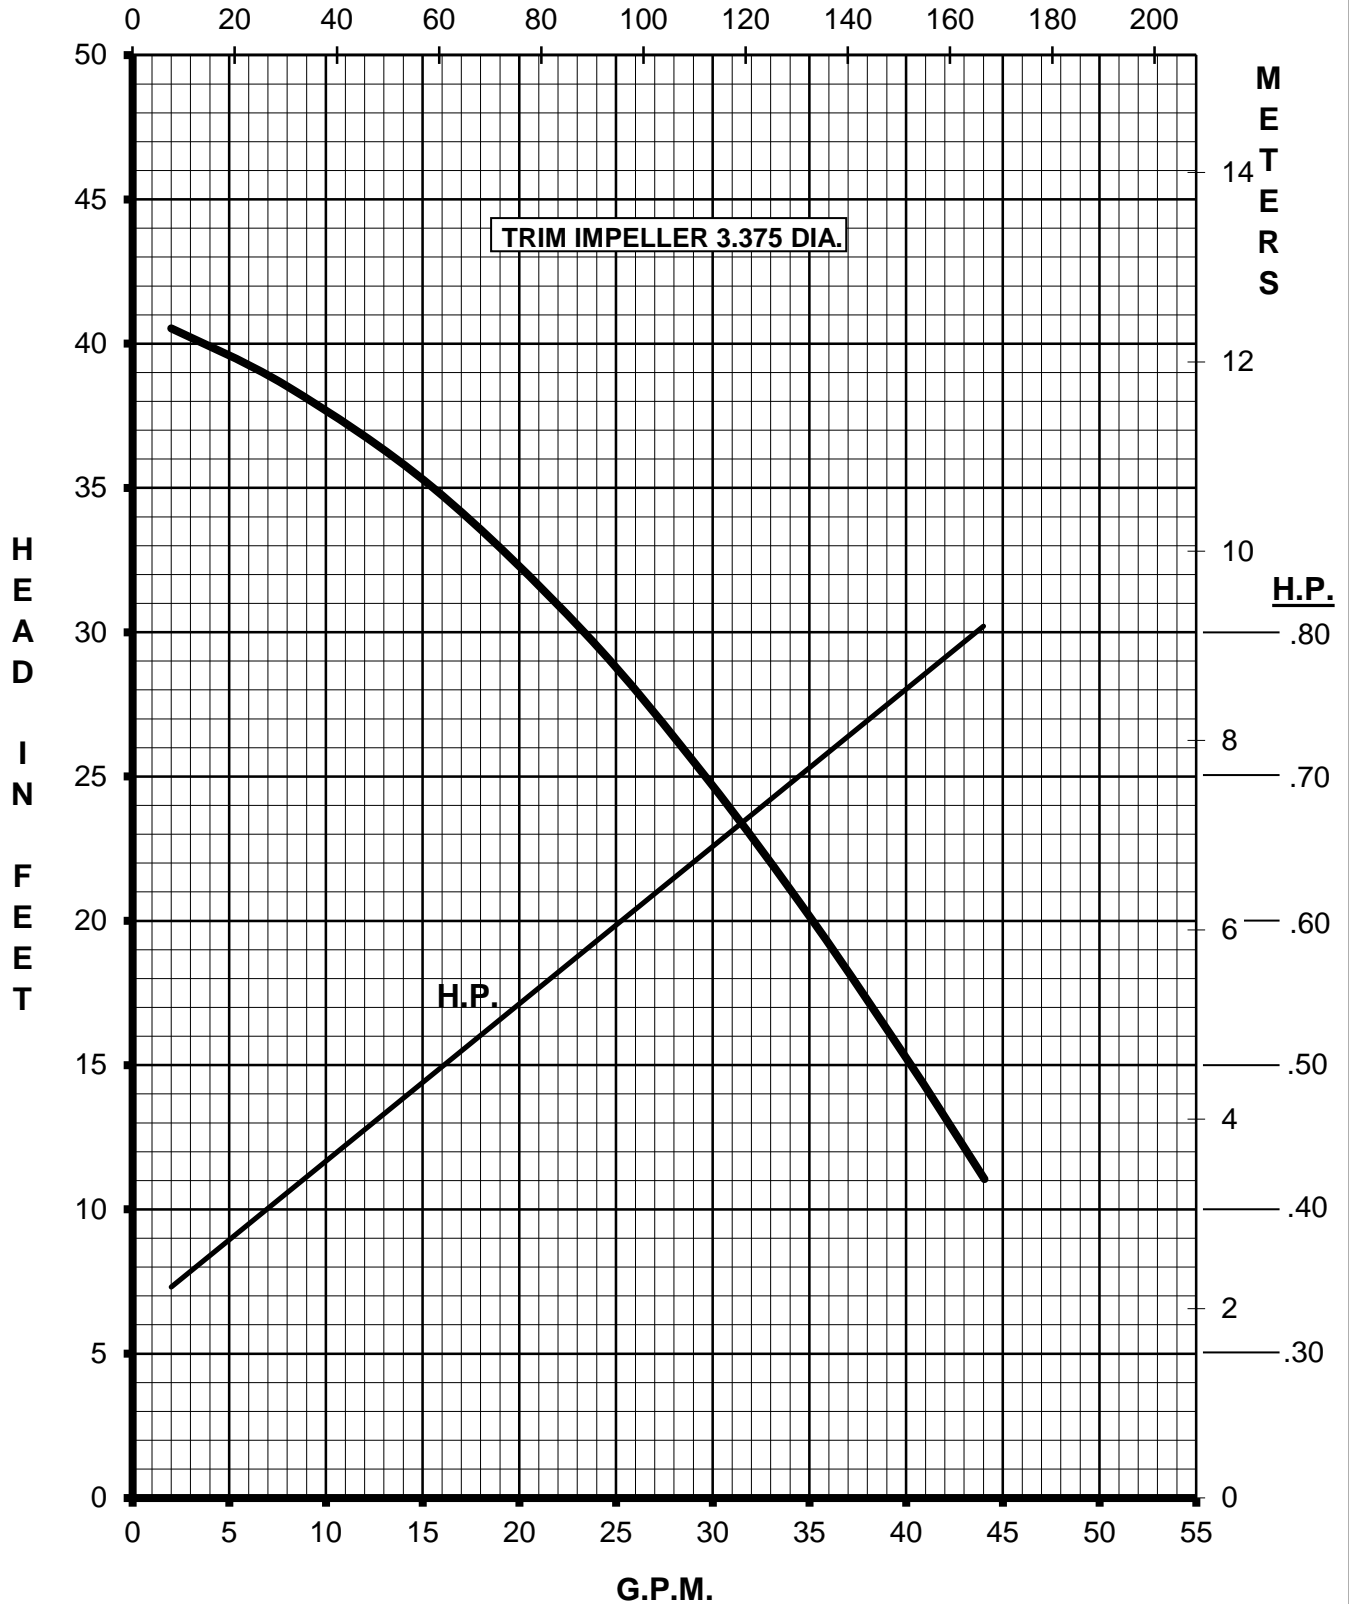


CURVES ARE AT 1FT SUCTION LIFT



MARCH PUMPS

SP-TE-7P-MD
SP-TE-7K-MD
TRIM IMPELLER 3.250 DIA.
1PH, 3PH 60HZ
L.P.M.

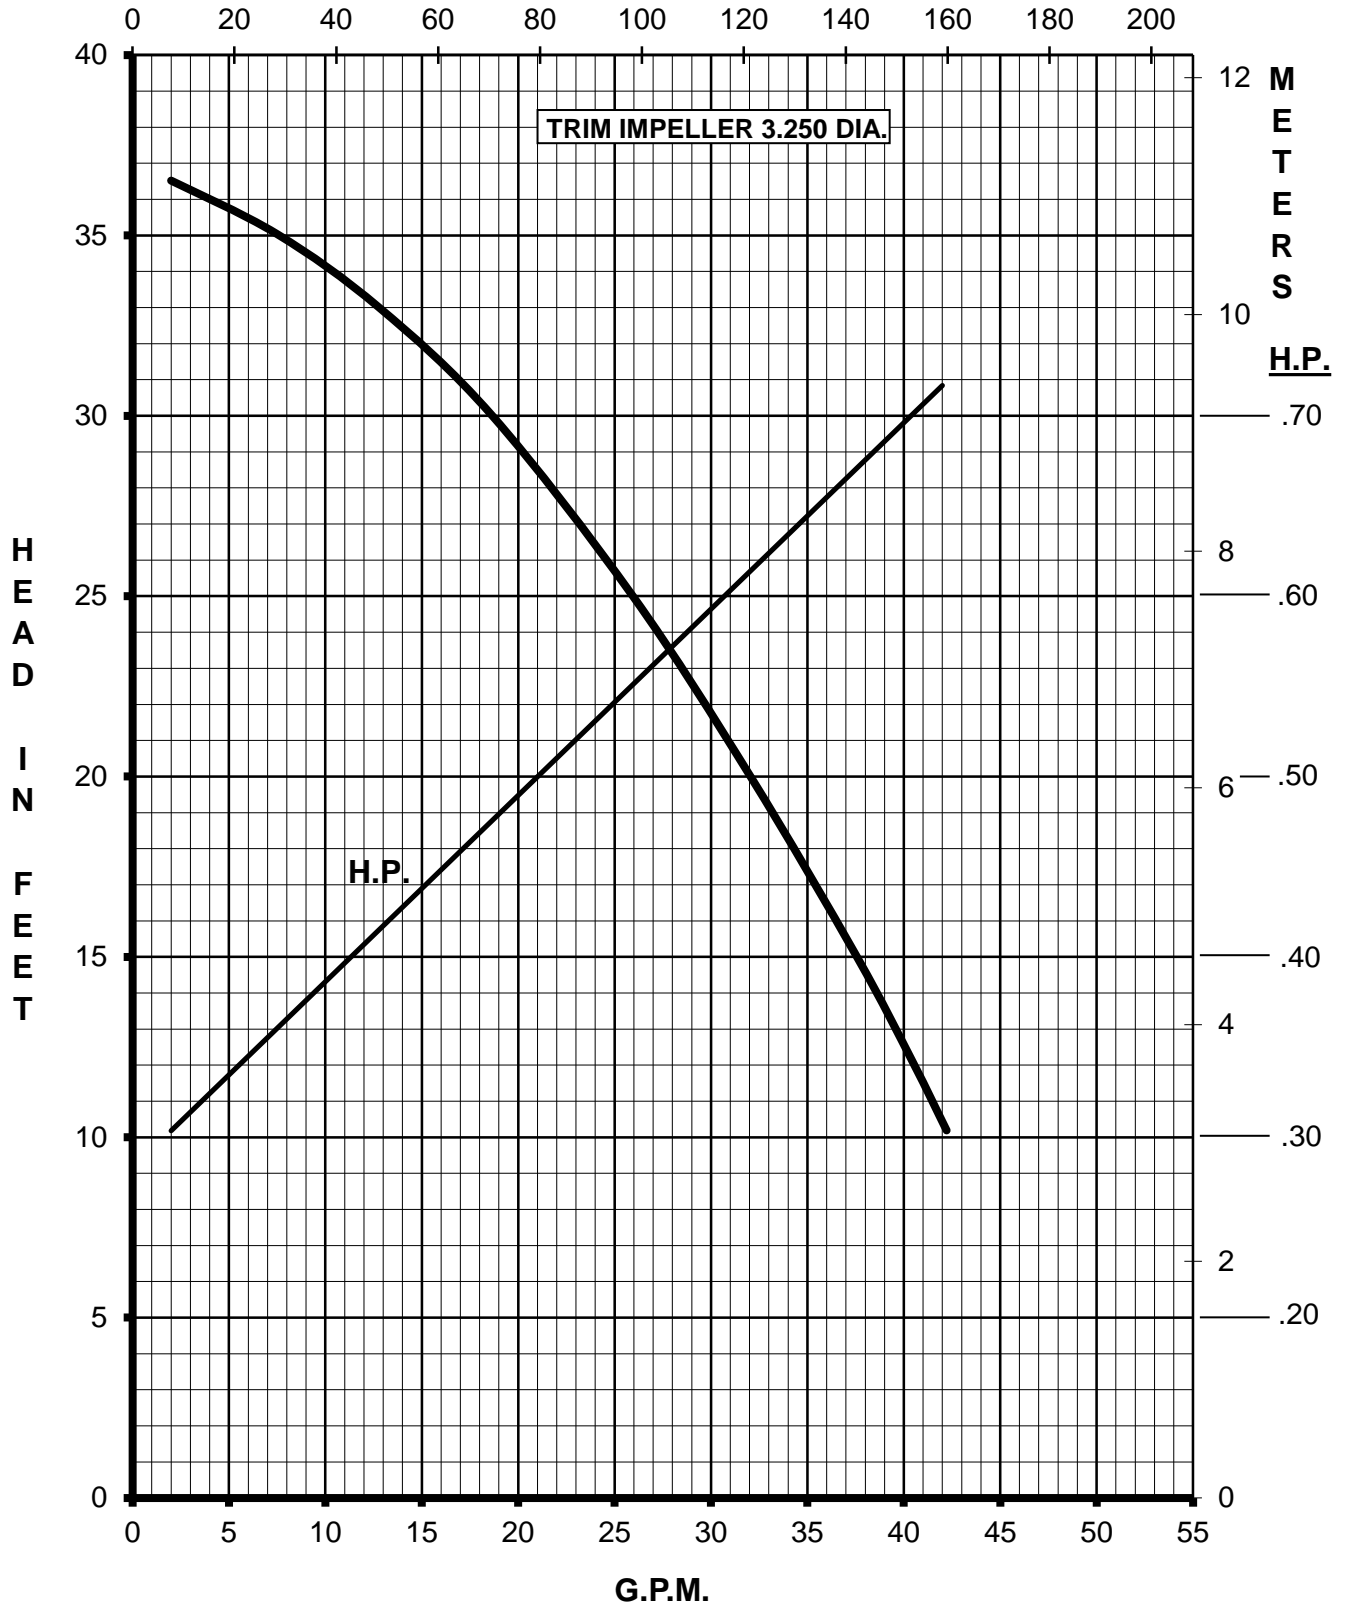
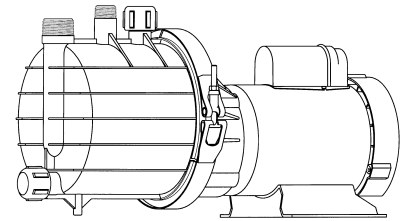


CURVES ARE AT 1FT SUCTION LIFT



MARCH PUMPS

SP-TE-7P-MD
SP-TE-7K-MD
TRIM IMPELLER 3.125 DIA.
1PH, 3PH 60HZ
L.P.M.

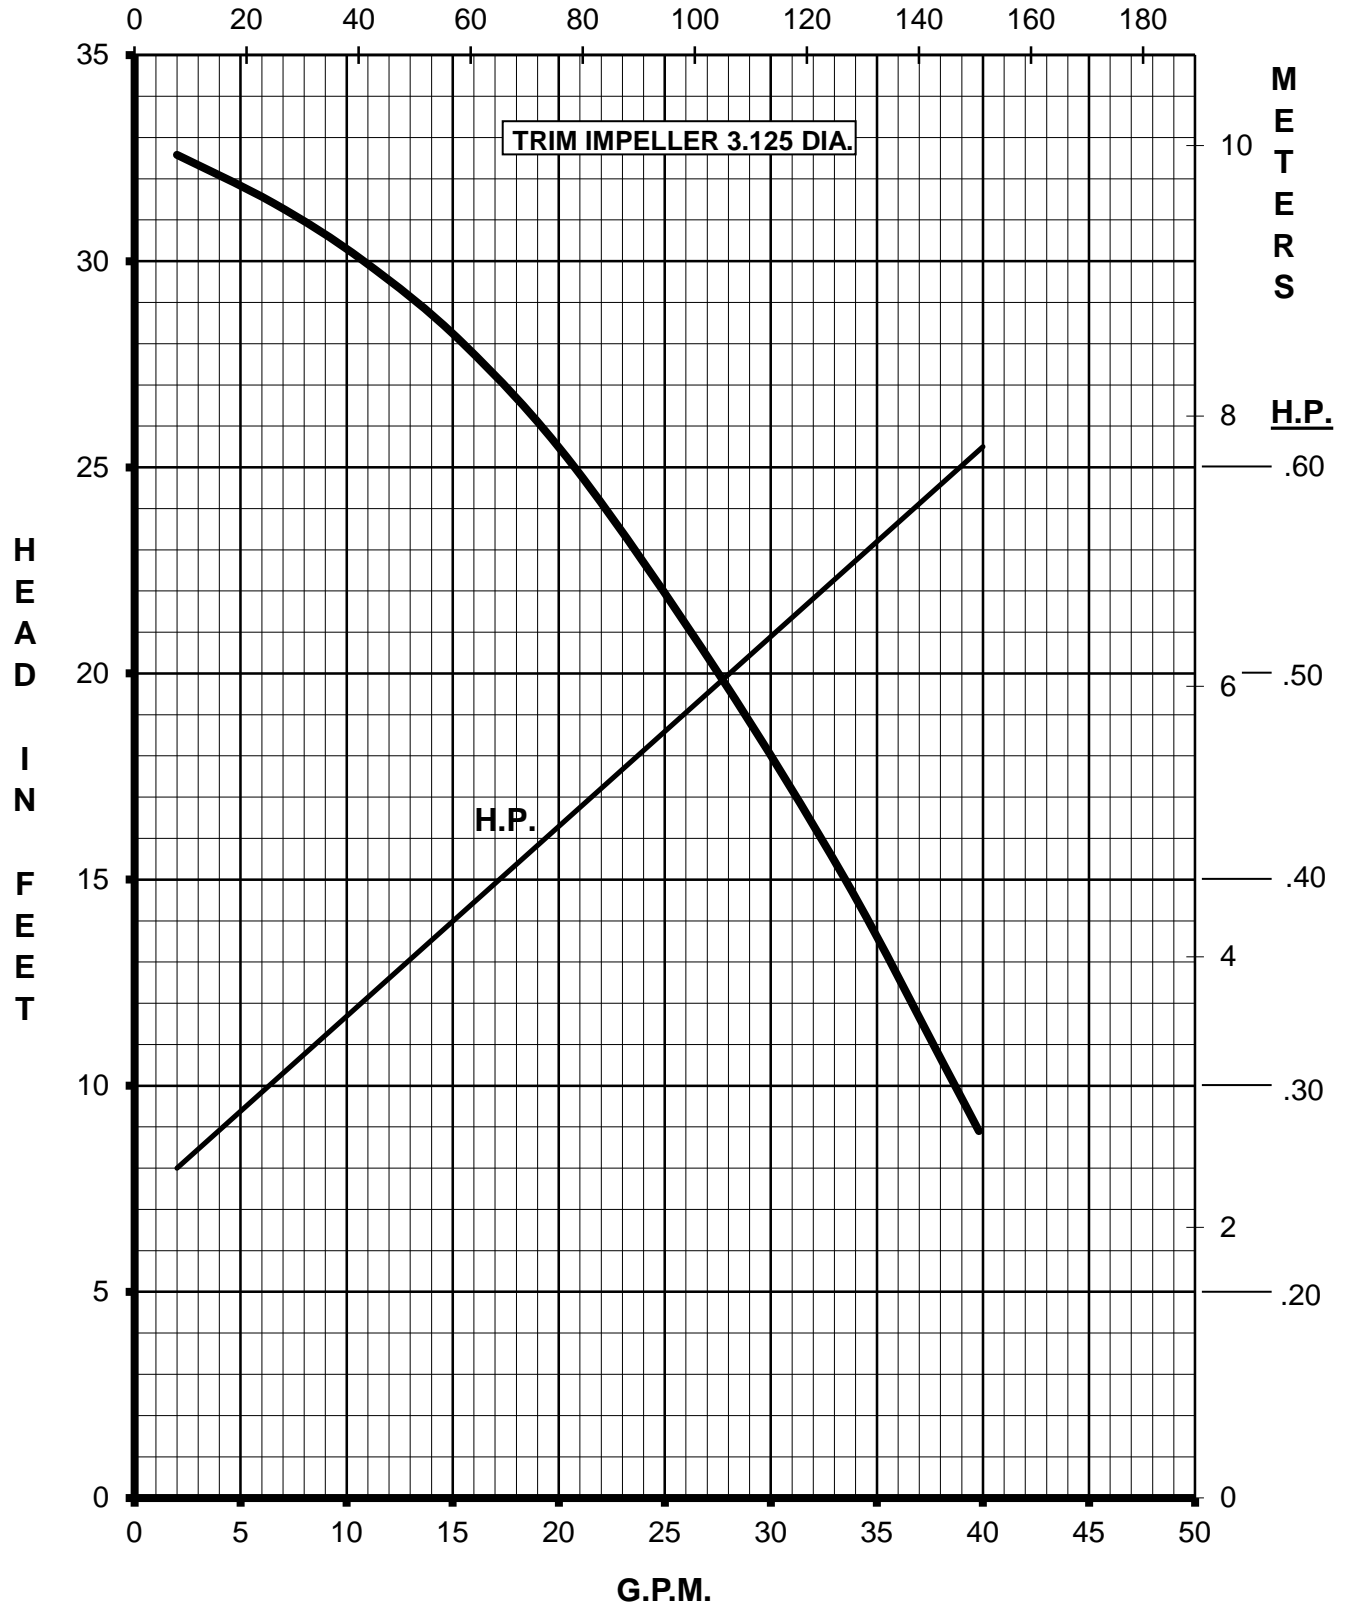
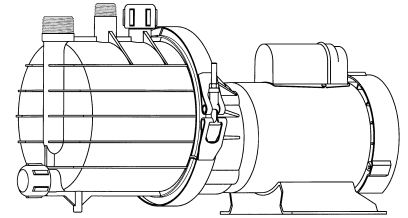


CURVES ARE AT 1FT SUCTION LIFT



MARCH PUMPS

SP-TE-7P-MD
SP-TE-7K-MD
TRIM IMPELLER 3.000 DIA.
1PH, 3PH 60HZ
L.P.M.

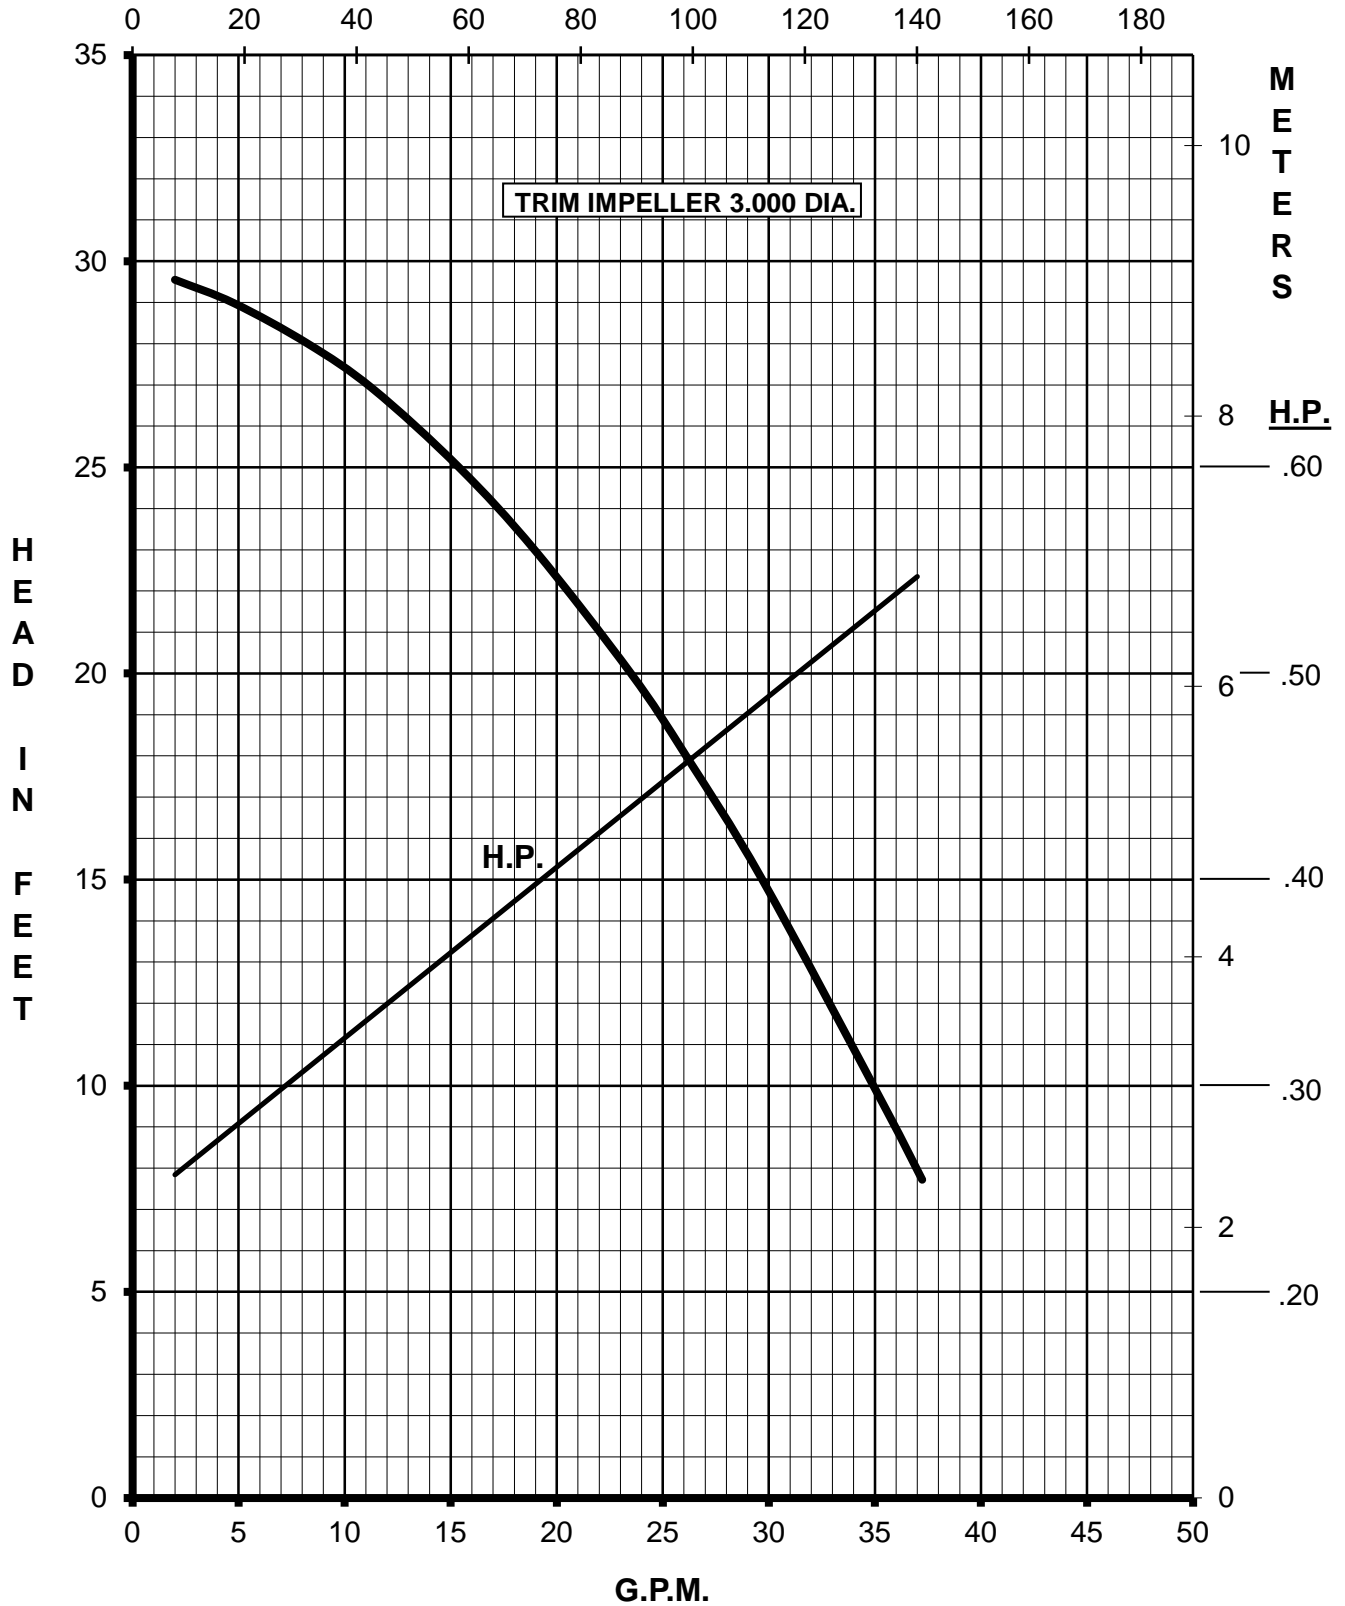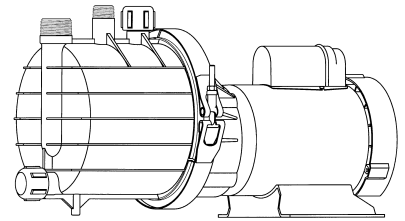

CURVES ARE AT 1FT SUCTION LIFT